

Alternator Winding Temperature Rise in Generator Systems

Information Sheet # 34

1.0 Introduction

When a wire carries electrical current its temperature will increase due to the resistance of the wire. The factor that mostly influences/limits the acceptable level of temperature rise is the insulation system employed in an alternator. So the hotter the wire, the shorter the life expectancy of the insulation and thus the alternator.

This information sheet discusses how different applications influence temperature rise in alternator windings and classification standards are covered by the National Electrical Manufacturers Association (NEMA).


Table 1 - Maximum Temperature Rise (40 °C Ambient)

Continuous				
Temperature Rise	Class A	Class B	Class F	Class H
Temp. Rise °C	60	80	105	125
Temp. Rise °F	108	144	189	225

Table 2 - Maximum Temperature Rise (40 °C Ambient)

Standby				
Temperature Rise	Class A	Class B	Class F	Class H
Temp. Rise °C	85	105	130	150
Temp. Rise °F	153	189	234	270

Typical Windings Within a Generator Set's Alternator

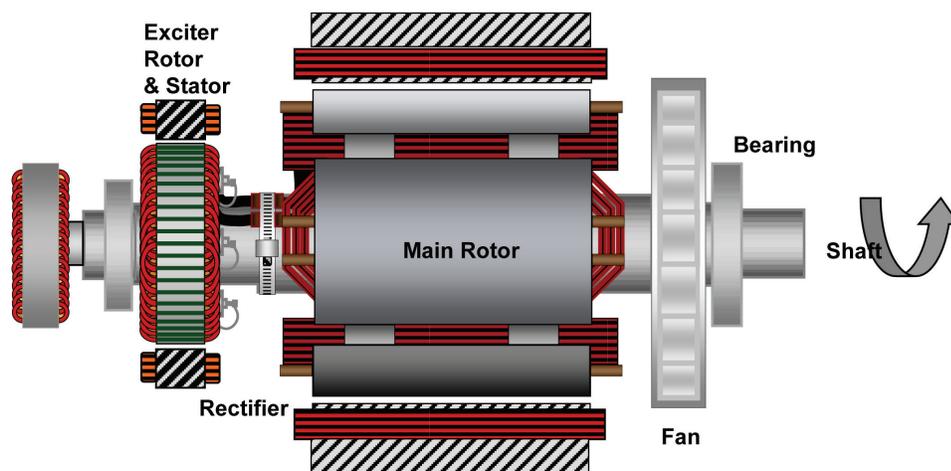

To fulfill our commitment to be the leading supplier and preferred service provider in the Power Generation Industry, the Central Power Systems & Services team maintains up-to-date technology and information standards on Power Industry changes, regulations and trends. As a service, our **Information Sheets** are circulated on a regular basis, to existing and potential Power Customers to maintain awareness of changes and developments in engineering standards, electrical codes, and technology impacting the Power Generation Industry.

The installation information provided in this information sheet is informational in nature only, and should not be considered the advice of a properly licensed and qualified electrician or used in place of a detailed review of the applicable National Electric Codes and local codes. Specific questions about how this information may affect any particular situation should be addressed to a licensed and qualified electrician.

Liberty - Corporate Office
9200 Liberty Drive
Liberty, MO 64038
816.781.8070 Ph
816.781.2207 Fax

Liberty, MO Branch
1900 Plumbers Way
Liberty, MO 64038
816.415.6700 Ph
816.415.6767 Fax

Springfield, MO Branch
3100 E. Kearney
MO 65803
417.865.0505 Ph
417.865.4304 Fax

Wichita, KS Branch
4501 W. Irving
KS 67209
316.943.1231 Ph
316.943.4560 Fax

Salina, KS Branch
1944B N. 9th St.
KS 67401
785.825.8291 Ph
785.825.8282 Fax

Great Bend, KS Branch
625 E. 10th St.
KS 67530
620.792.1361 Ph
620.792.1364 Fax

Colby, KS Branch
1920 Thielen Ave.
KS 67701
785.462.8211 Ph
785.462.8286 Fax

Liberal, KS Branch
1150 E. Hwy. 54
KS 67901
620.624.7274 Ph
620.624.7277 Fax

Woodward, OK Branch
127 NW Hwy. 270
OK 73801
580.256.6014 Ph
580.256.0314 Fax



2.0 Classification Standards Covered by NEMA:

(NEMA) Standard MG1, which encompasses the entire machine and includes the requirements for alternator temperature rise. The standard operating ambient temperature in all cases is 40°C (104°F).

Categories. MG1 defines two duty cycles for the alternator:

- **Continuous Duty** – for operation 24-hours a day, 7- days a week, under full load conditions
- **Standby Duty** – for an emergency power source (EPS) - or standby generator set. This is designed to operate as back-up power should the principal power source (utility) be lost or fall outside the nominal frequency or voltage requirements

3.0 Hours Limitation for Temperature Rise:

As the standby category (NEMA MG1 – 22.40) has no defined hour limits, the EPS is considered to typically run for about 200 hours or less a year – considerably fewer than that for a continuous duty application. This higher temperature rise allows more kW to be utilized and is justified by the higher standby output ratings commonly found on most emergency generator sets. However, the insulation of a standby unit will age thermally at about four to eight times that of a continuously rated alternator.

4.0 Insulation Classes: (See chart 1 for classification)

NEMA MG1 recognizes four classes of electrical insulation of the alternator:

- A
- B
- F
- H

Each of these classes have different characteristics, but the accepted common feature is an anticipated minimum life expectancy of 30,000 hours. The letter signifies the maximum allowable windings temperature allowable while the alternator is operating, if exceeded the insulation will breakdown resulting in winding burn out.

See temperature rise Tables 1 (for Continuous Duty) and 2 (for Standby Duty) overleaf

5.0 NEMA Standby Ratings:

As standby duty results in fewer hours of operation, NEMA MG1 allows alternator windings to operate at 25°C higher than for continuous duty applications. If used for continuous duty or prime power, the standby alternator’s useful working life will be considerably shortened and reliability may well become an issue.

Most manufacturers of alternators supply the market with Class H insulation, which meets most of the normal applications and duties that are encountered. Many manufacturers will supply insulation class H while meeting class F standby ratings with the same machine.

6.0 Application where a lower winding temperature rise is required:

There are a number of generator applications where a much lower temperature rise is required, in order to handle the type of electrical load and duty cycle.

Prime power applications such as oil field rigs frequently run throughout the year. Heavy-duty cycles usually specify a maximum winding temperature rise of 70°C at 40°C ambient. A lower temperature rise in prime power applications increases reliability with less winding failures because the insulation was subjected to less heat for extended periods.

7.0 Accomplishing Lower Temperature Rises:

The prime factor for a lower temperature rise in all alternators is the size and material of the steel laminations, the length of the lamination stack and the amount of copper wire used. This, added to the design of the amount of cooling air driven through the alternator, will affect the machines output and temperature behavior.

A larger alternator is applied for a lower temperature rise with increased copper resulting in lower current density. Increased size and copper permits higher motor starting kVA and lower voltage dips on application of the load. It also means reduced voltage distortion and overheating, due to harmonics induced by non-linear loads

The temperature class of the insulation system is typically determined using the test methods outlined in Underwriters Laboratory standard UL 1446 (Systems of Insulating Materials – General)

8.0 Checking Deterioration of Winding Insulation:

Winding insulation should be checked if the generator has been subjected to any of the following:

- Been stationary for a long period without anti-condensation heaters turned on
- Been subject to an intake of high volumes of water
- Windings are contaminated with airborne dust and dirt, or may have become damp due to high humidity
- Windings are contaminated with airborne corrosive elements such as salt or corrosive chemicals in the atmosphere